


T-JOINT REQUIREMENTS

and the same of th			Ch.
MEMBRANE	THICKNESS		
	45/50	60	80
PVC	N/A	N/A	YES
KEE HP	N/A	N/A	YES
TPO	N/A	YES	YES


NOTES:

- ON MECHANICALLY ATTACHED SYSTEMS, HPWX FASTENERS AND PLATES ARE REQUIRED OVER STEEL AND WOOD DECKS. ON CONCRETE DECKS, APPROVED CONCRETE FASTENERS ARE USED WITH HPWX PLATES.
- 2. POSITION SEAM FASTENING PLATES BEYOND NON-REINFORCED ENCAPSULATED EDGE.
- 3. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF WEATHERBOND REINFORCED TPO MEMBRANE.

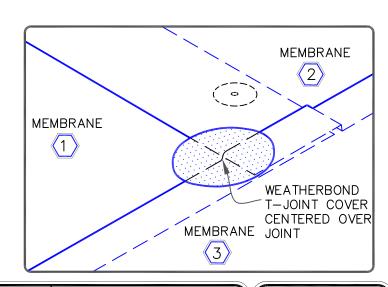



MECHANICALLY ATTACHED MEMBRANE SPLICE



THERMOPLASTIC ROOFING SYSTEM

WBPMA-2.1