

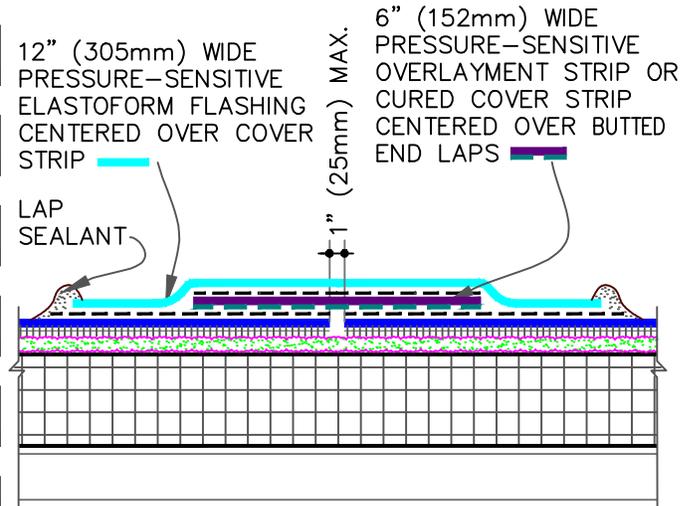
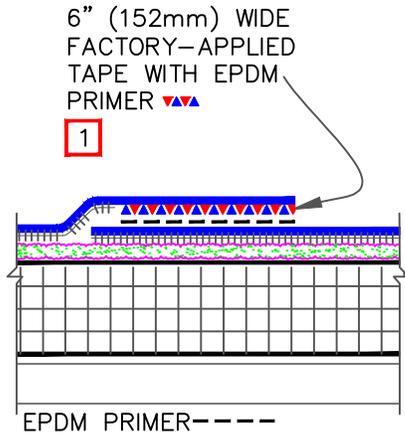


MEMBRANE SPLICE

END LAP SPLICE

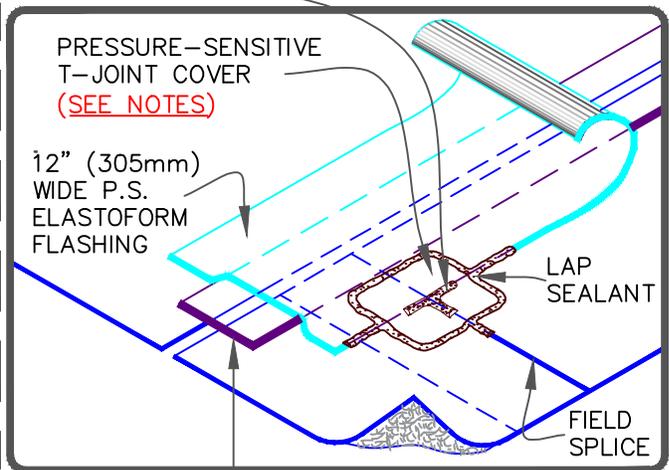

LAP SEALANT UNDER  
T-JOINT COVER

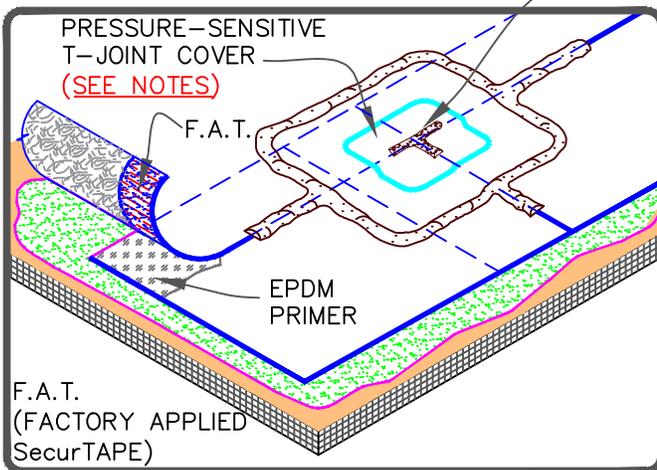

6" (152mm) WIDE  
PRESSURE-SENSITIVE  
OVERLAYMENT STRIP OR  
CURED COVER STRIP  
CENTERED OVER BUTTED  
END LAPS

NOTES:

1. APPLY EPDM PRIMER TO MEMBRANE SURFACES PRIOR TO INSTALLING PRESSURE-SENSITIVE FLASHING AND/OR FACTORY APPLIED SecurTAPE.
2. APPLY LAP SEALANT ALONG THE EDGE OF THE MEMBRANE SPLICE (UNDER THE 6"x6" T-JOINT COVER) COVERING THE EXPOSED SPLICE TAPE 1/2" (13mm) IN EACH DIRECTION FROM THE SPLICE INTERSECTION.
3. ALL EPDM SPLICE INTERSECTIONS MUST BE OVERLAID WITH TWO LAYERS OF PRESSURE-SENSITIVE ELASTOFORM FLASHING. THE BOTTOM LAYER SHALL BE 6"x6" (152mm X 152mm) COVERED WITH A 12"x12" TOP LAYER (305mm X 305mm). BOTH LAYERS SHALL BE CENTERED OVER THE SPLICE INTERSECTION AND SEALED WITH CONTINUOUS LAP SEALANT, AS SHOWN.

6/26/2017 REVISED

	<p>→ FleeceBACK MEMBRANE</p> <p>→ FAST ADHESIVE/AQUABASE</p> <p>→ APPROVED SUBSTRATE</p> <p>→ SEE NOTE(S)</p>
--	---

<p>EPDM MEMBRANE SPLICES- PROJECTS WITH 145-MIL MEMBRANE OR 25 and 30-YEAR WARRANTIES</p> <p>For additional information, refer to Specifications</p>
--

<p>DETAIL NO.</p> <p>FB-2A.1</p> <p>FLEECEBACK ADHERED</p>
--