

REMOVE EXISTING RIDGE/HIP CAP & ITS FASTENERS

EXISTING RIDGE CAP

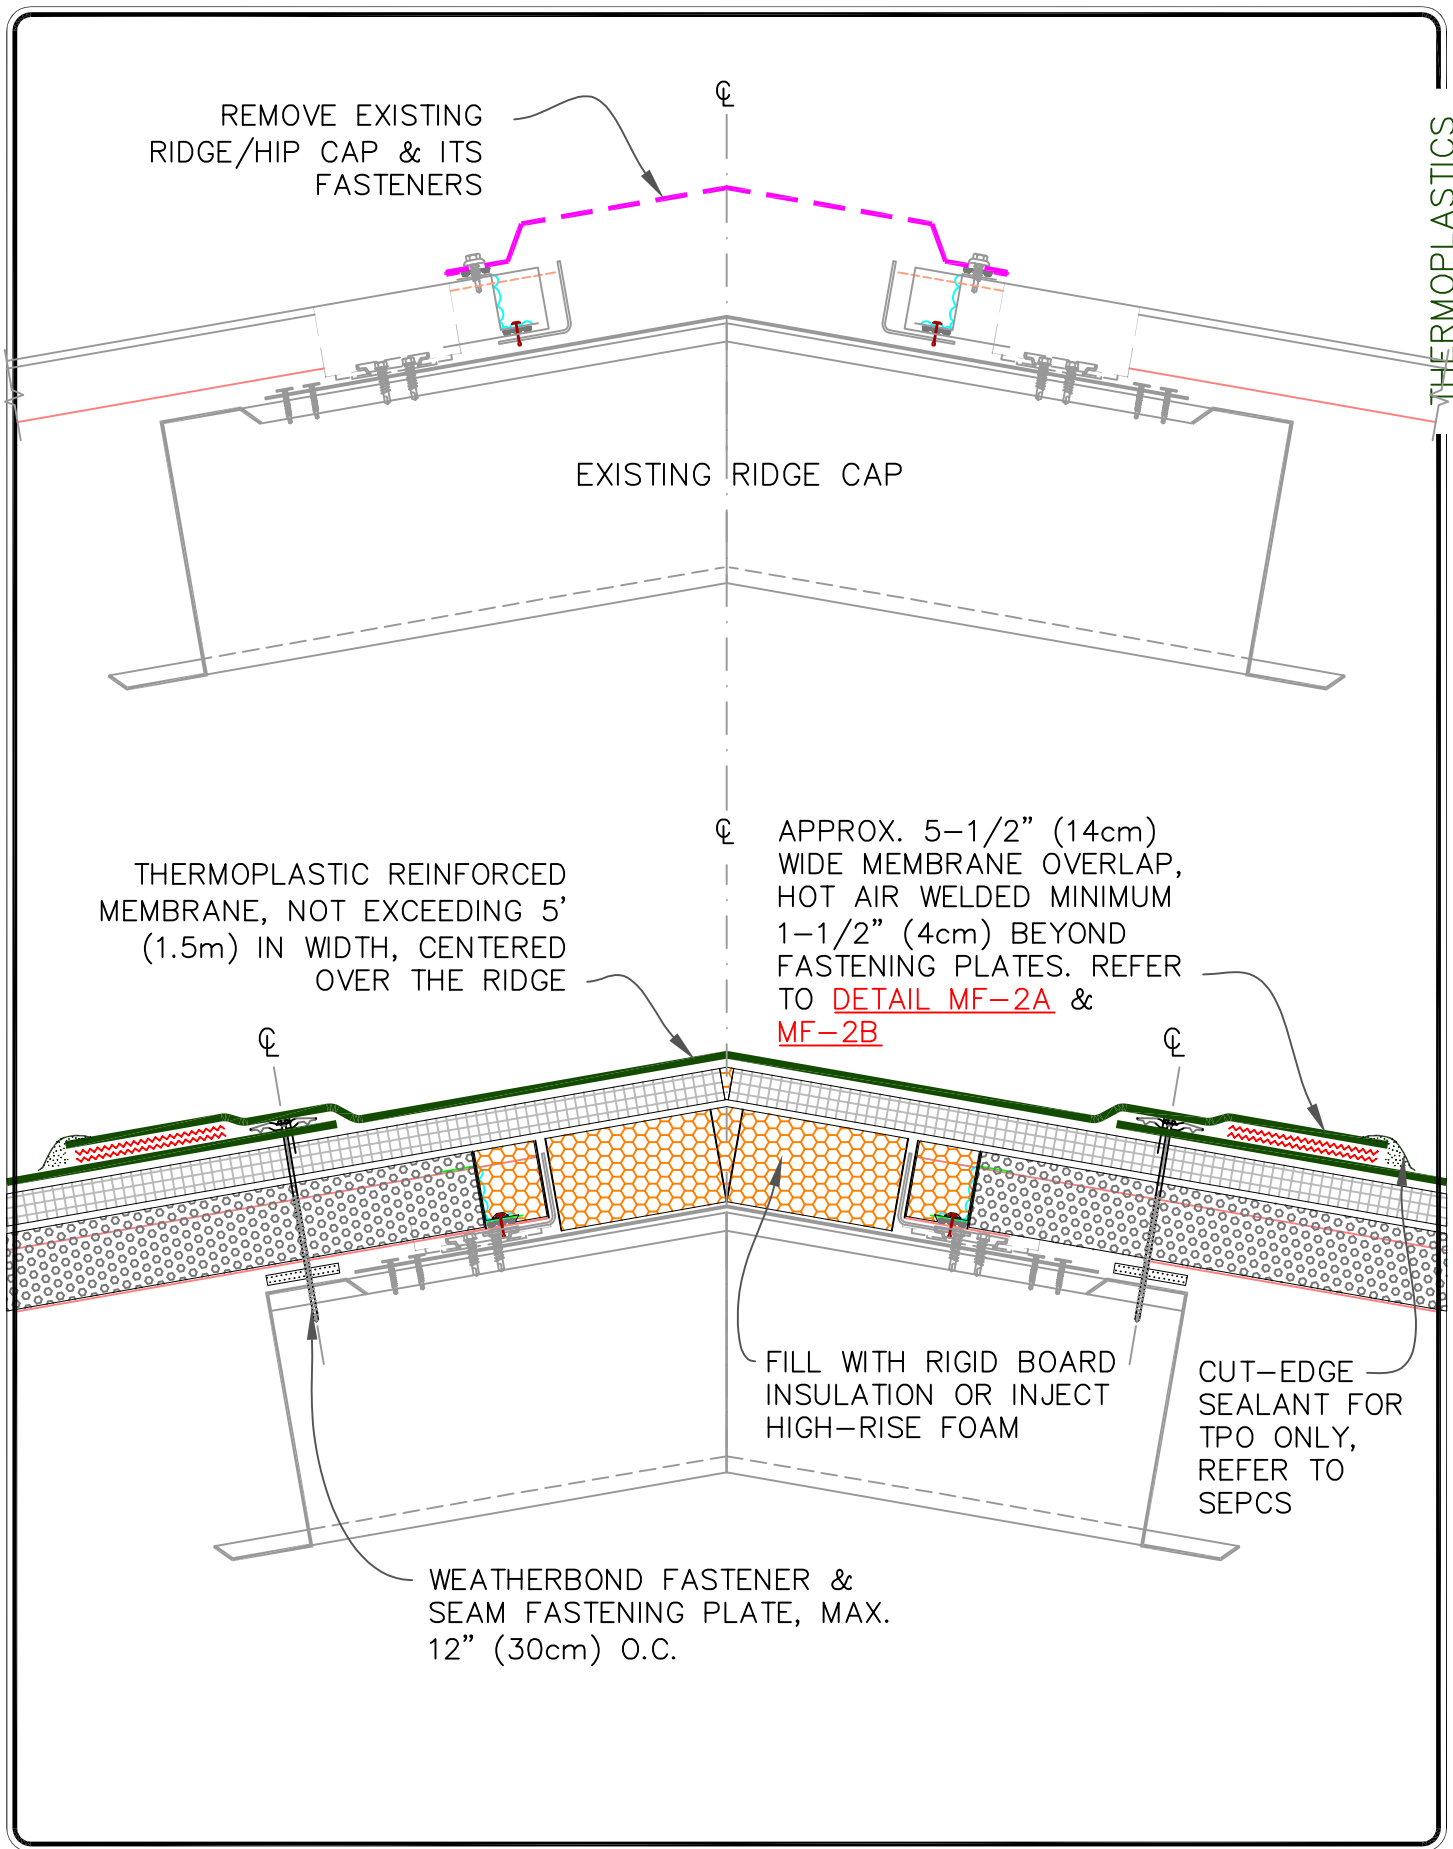
THERMOPLASTIC REINFORCED MEMBRANE, NOT EXCEEDING 5' (1.5m) IN WIDTH, CENTERED OVER THE RIDGE

APPROX. 5-1/2" (14cm) WIDE MEMBRANE OVERLAP, HOT AIR WELDED MINIMUM 1-1/2" (4cm) BEYOND FASTENING PLATES. REFER TO [DETAIL MF-2A](#) & [MF-2B](#)





FILL WITH RIGID BOARD INSULATION OR INJECT HIGH-RISE FOAM

CUT-EDGE SEALANT FOR TPO ONLY, REFER TO SEPCS

WEATHERBOND FASTENER & SEAM FASTENING PLATE, MAX. 12" (30cm) O.C.



ROOF RIDGE / HIP
NON-VENTED

-  HIGH DENSITY RECOVER BOARD
-  IN-FILL INSULATION
-   SEE NOTE(S)

METAL RETROFIT
MR | T22.1