



NOTES:

1. THIS DETAIL FOR USE WHEN A RELIEF CUT OR MEMBRANE SPLICE IS PRESENT AT THE PIPE SEAL. USE DETAIL [WBRC-8.1](#) WHEN NO CUT OR SPLICE IS PRESENT.
2. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING PEEL & STICK PIPE SEAL.
3. PIPE SEAL MUST HAVE INTACT RIB AT TOP EDGE, REGARDLESS OF PIPE DIAMETER.
4. DECK FLANGES OF THE MOLDED PIPE SEAL SHALL NOT BE OVERLAPPED, CUT OR APPLIED OVER ANY ANGLE CHANGE.
5. ON MECHANICALLY FASTENED ROOFING SYSTEMS REFER TO DETAIL [WBRMA-8.3](#).

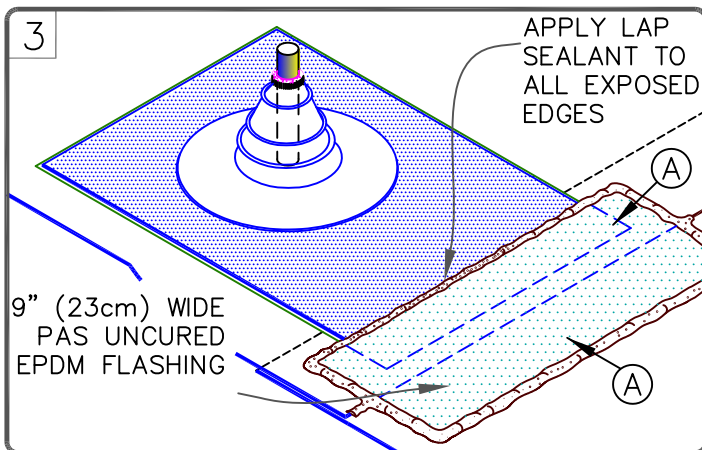

DIMENSIONS	cm	
(A)	3"	7.5 MIN.
(B)	1"	2.5 MIN.

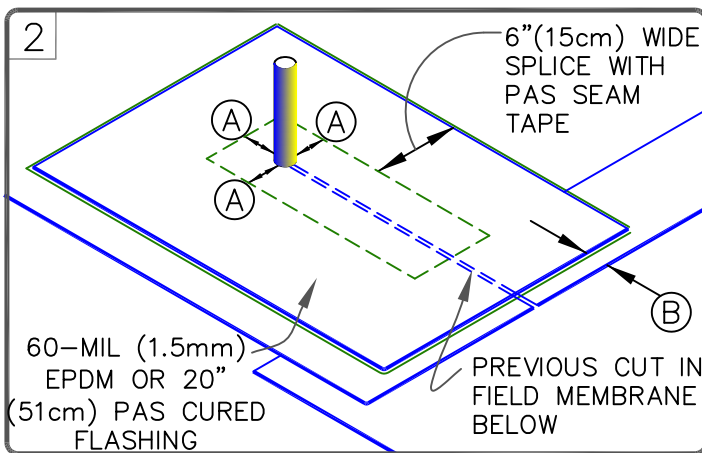

PRE-MOLDED PEEL & STICK PIPE SEAL WITH 90-MIL MEMBRANE

—• EPDM MEMBRANE

—• APPROVED SUBSTRATE

0 —• SEE NOTE

EPDM ROOFING SYSTEM

WBRC-8.1B